
GROUNDTEC
DEVELOPMENTS LTD

Infiltration Testing: Date: 20th November 2024
Site: 1 Toll Bar Lane Keyston

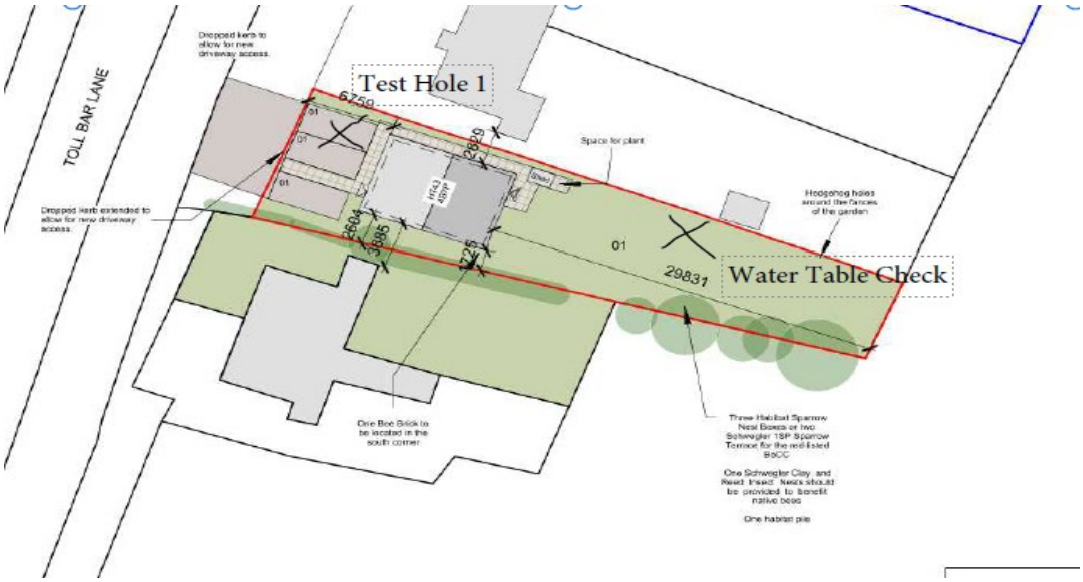

Water Table Check

Depth = 2.3m

Ground Make Up:

Depth from	Depth to	
GL:	0.3	Clay like topsoil some vegitation
0.3	1.3	Brown clay
1.3	2.3	Brown clay some large flints and chalky deposits
		No Water found at base





Test hole 1

Ground Make Up:

Depth from	Depth to	
GL:	0.3	Clay like topsoil some vegitation
0.3	1.2	Brown clay

(m)

Pit Depth: 1.2

Pit Width: 0.3

Pit Length: 1.2

Fill level:

Test Start:

Test 1		**Test 2**	
Time (mins)	**Water Level mm**	**Time (mins)**	**Water level mm**
0	400	0	
30	400	30	
60	400	60	
90	400	90	
120	400	120	
150		150	
180		180	
210		210	

Test abondoned due to zero drainage





