
Dimensions are not to be scaled from this drawing


Kingfisher Lighting

Part of the Luceco PLC group of companies LUCECO

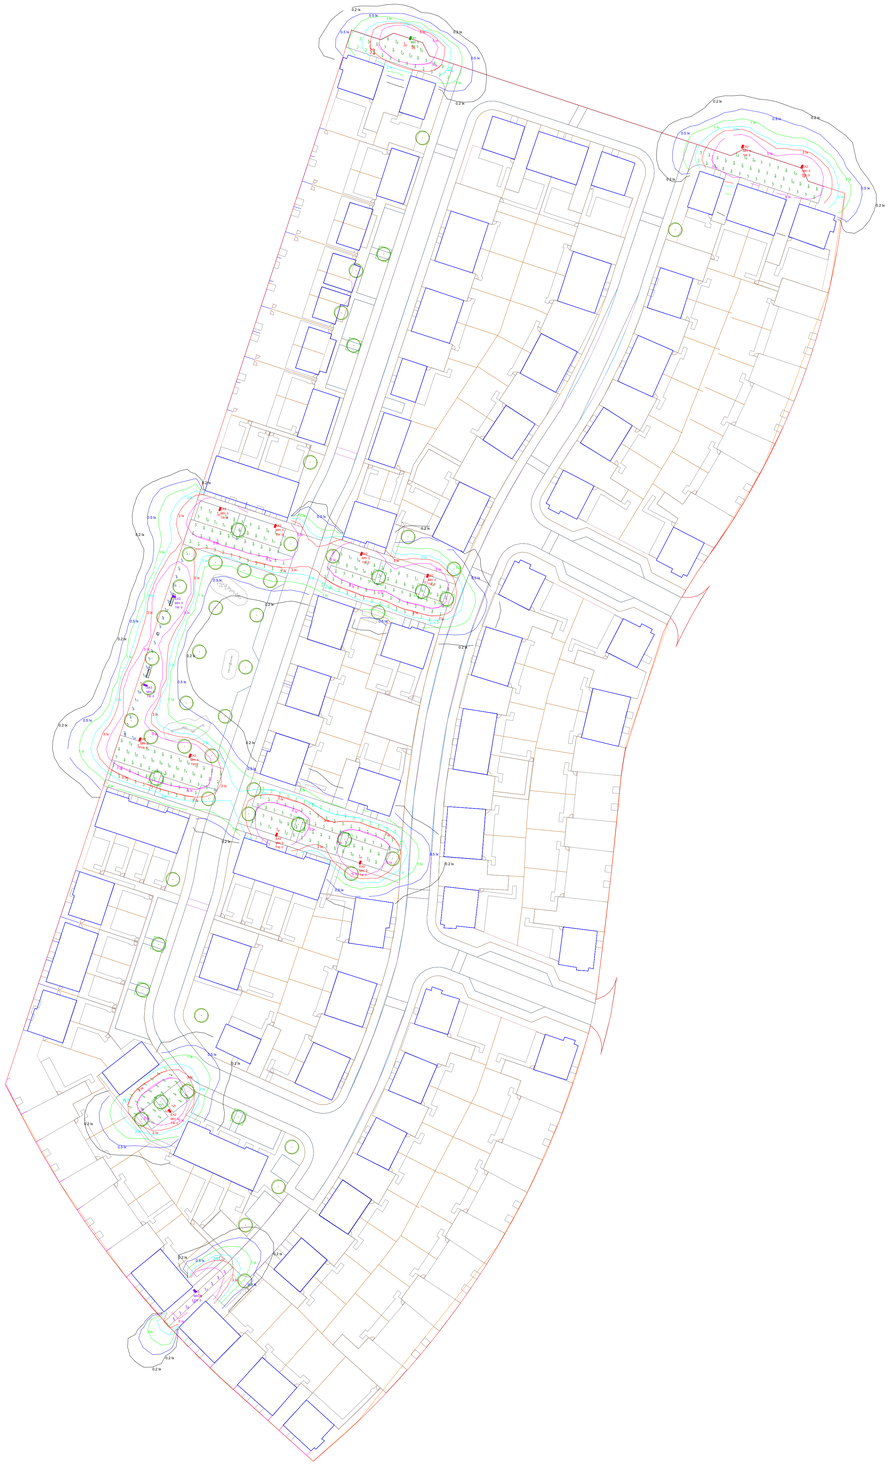

Luminaire Schedule					
Symbol	Qty	Label	Arrangement	Description	Lum. Lumens
	1	EX1	SINGLE	11.9W LED 4000K 60mA ITALO 1 (1 module) with STE-M optic column mounted at 5m	1760
	11	EX2	SINGLE	11.9W LED 4000K 60mA ITALO 1 (1 module) with SO5 optic column mounted at 5m	1730
	3	EX3	SINGLE	11.9W LED 4000K 60mA ITALO 1 (1 module) with SV optic column mounted at 5m	1760

Calculation Summary							
Label	CalcType	Units	Avg	Max	Min	Min/Avg	Min/Max
Park Footpath	Illuminance	Lux	10.56	24	4	0.38	0.17
Private Drive 1-2	Illuminance	Lux	6.66	20	2	0.30	0.10
Private Drive 108 & 143	Illuminance	Lux	6.18	15	2	0.32	0.13
Private Drive 116,117,137-139	Illuminance	Lux	0.00	0	0	N.A.	N.A.
Private Drive 15-18	Illuminance	Lux	7.33	16	2	0.27	0.13
Private Drive 21,22,78,40 & 76	Illuminance	Lux	6.12	15	2	0.33	0.13
Private Drive 48-51	Illuminance	Lux	7.64	14	2	0.26	0.14
Private Drive 83-98	Illuminance	Lux	5.14	14	2	0.39	0.14
Private Drive 99-102	Illuminance	Lux	7.28	16	2	0.27	0.13
South Footpath	Illuminance	Lux	9.73	24	3	0.31	0.13



N

Wintringham Parcel 5 Lovell

Scale	Project Number
1:500 at A0	D45704C
Date	Drawing No.
25 November 2024	D45704/JB/C

Lighting Designer : J Buck MSLL

For our LED lighting designs a 0.9mf has been used. If this differs from the maintenance period for this project then you must advise us accordingly

A lighting applications design service is provided by us in good faith and without charge, relating to Kingfisher products only. As such, whilst every endeavor is made for accuracy from information provided by yourselves, the final responsibility for the suitability of the design lies with the client. The company cannot, therefore, accept any liability or consequential loss incurred.

A0